

PTU300 Combined Pressure, Humidity and Temperature Transmitter

for Demanding Applications



Features

- Barometric pressure, humidity, and temperature measurement in one transmitter
- RS-232C serial interface with NMEA protocol for GPS use
- Graphical display and keypad for convenient operation
- Analog outputs, RS-232/485, LAN
- Modbus protocol support (RTU/ TCP)
- Traceable to international standards

Vaisala Combined Pressure, Humidity and Temperature Transmitter PTU300 is a unique instrument measuring three parameters simultaneously.

Options

- Available with up to two barometric pressure sensors for added reliability
- Optional universal power supply module
- HMT330MIK installation kit for outdoor use

You can choose from the following probe options: PTU301 for wall mounting for example in laboratories or engine rooms, PTU303 for general use, PTU307 warmed probe for outdoor and demanding meteorology applications, and PTU30T for pressure and temperature measurement only.

Proven Vaisala Sensor Technology

PTU300 incorporates sensors known for their high accuracy and excellent longterm stability: Vaisala BAROCAP® for pressure measurement and Vaisala HUMICAP® for humidity measurement. The temperature sensor is a platinum RTD sensor.

Graphical Display of Measurement Data and Trends for Convenient Operation

PTU300 features a large numerical and graphical display with a multilingual menu and keypad. It allows users to easily monitor operational data, measurement trends, and access measurement history for the past 12 months.

The optional data logger, with real-time clock, makes it possible to generate over four years of measurement history and zoom in on any desired time or time frame.

The display alarm allows any measured parameter to be tracked, with freely configurable low and high limits.

Versatile Outputs and Data Collection

PTU300 comes with a standard RS-232 serial interface. The output format is compatible with major GPS receivers and NMEA-coded messages. An isolated RS-485 is available as an option. PTU300 is also capable of applying the Modbus communication protocol and, together with an appropriate connection option, provides either Modbus RTU (RS-485) or Modbus TCP/IP (Ethernet) communication.

The data logger records data that can be viewed on the local display or transferred to a PC with Microsoft Windows software. The transmitter can also be connected to a network with an optional LAN interface, which enables an Ethernet connection. A USB service cable makes it easy to connect PTU300 to a PC via the service port.

Outdoor Installation Kit

Outdoor installation is possible using the optional HMT330MIK installation kit, for applications requiring reliable measurements for meteorological purposes.

Flexible Calibration

Quick, one-point field calibration for humidity is easy using Vaisala Hand-Held Humidity Meter HM70. With Vaisala Barometric Pressure Transfer Standard PTB330TS, including optional humidity and temperature probe, field check and calibration can be performed for all three parameters.

Applications

- Environmental monitoring in calibration laboratories
- Industrial applications in semiconductor industry, engine testing and maritime sector
- GPS meteorology: estimating precipitable water vapor in the atmosphere, weather stations




The display also shows the WMO pressure trend ΔP 3h and tendency of 0 ... 8.

Model




Dimensions in mm

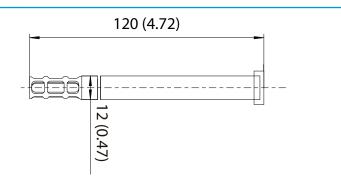

PTU301 for wall mounting




PTU301 short cable probe with optional WLAN

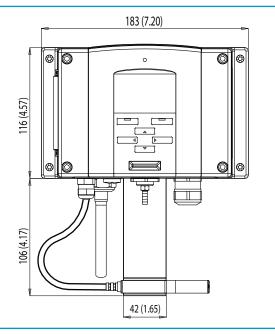


Model

Dimensions in mm

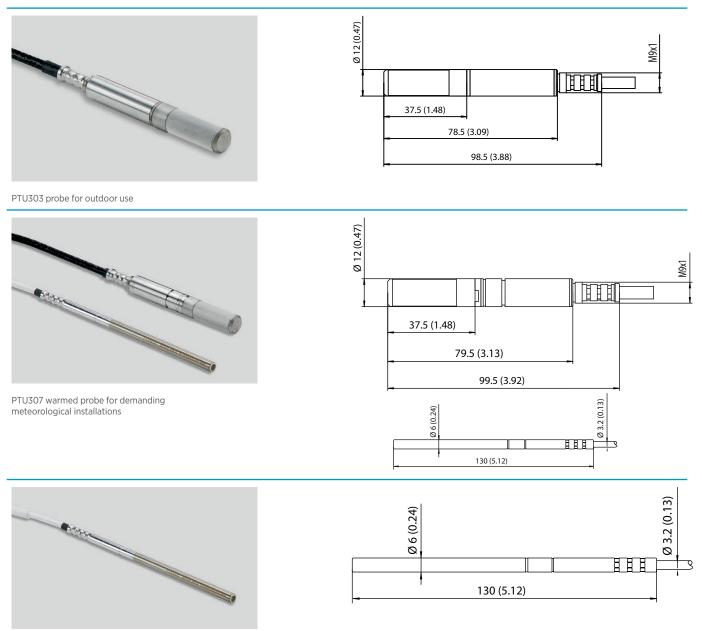

PTU30T for pressure and temperature only measurement

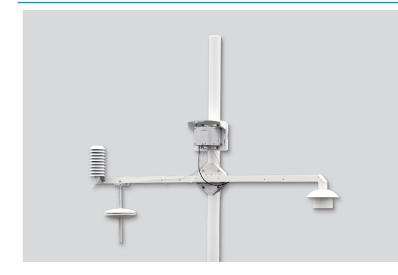

HMT330MIK Meteorological Installation Kit enables PTU307 to be installed outdoors to obtain reliable measurements for meteorological purposes.


Technical Data

Measurement Performance

Barometric Pressure

Barometric Pressur	e		
Pressure range		500 1100 hPa	50 1100 hPa
Accuracy	500 1100 hPa	500 1100 hPa	50 1100 hPa
	Class A	Class B	
Linearity	±0.05 hPa	±0.10 hPa	±0.20 hPa
Hysteresis	±0.03 hPa	±0.03 hPa	±0.08 hPa
Repeatability	±0.03 hPa	±0.03 hPa	±0.08 hPa
Calibration unceratinty	±0.07 hPa	±0.15 hPa	±0.20 hPa
Accuracy at +20 °C	±0.10 hPa	±0.20 hPa	±0.30 hPa
Temperature dependence	±0.1 hPa	±0.1 hPa	±0.3 hPa
Total accuracy (-40 +60 °C/ -40 +140 °F)	±0.15 hPa	±0.25 hPa	±0.45 hPa
Long-term stability/year	±0.1 hPa	±0.1 hPa	±0.2 hPa
Response Time (100) % Response):		
One sensor	2 s	1s	1 s
Pressure units	hPa, mbar, kPa, Pa,	inHg, mmH20, mmH	g, torr, psia
Relative Humidity			
Measurement range		0 100 %RH	
Accuracy (Including	Non-linearity, Hyste	resis, and Repeatabi	lity):
At +15 +25 °C At -20 +40 °C At -40 +60 °C		±1 %RH (0 90 %R ±1.7 %RH (90 100 ±(1.0 + 0.008 x read ±(1.5 + 0.015 x read	%RH) ding) %RH
Factory calibration uncertainty (+20 °C) (Defined as ±2 standard deviation limits. Small variations possible, see also calibration certificate.)		± 0.6 %RH (0 40 ± 1.0 %RH (40 97	
Sensor for typical applications Vaisala HUMICAP 180 or 180R			30 or 180R
Sensor for applications with chemical Vaisa purge/warmed probe		Vaisala HUMICAP 18	30C or 180RC
Response Time (90	%) at +20 °C (+68 °F	-) in Still Air:	
With grid filter With grid + steel netting filter With sintered filter		8 s / 17 s ¹⁾ 20 s / 50 s ¹⁾ 40 s / 60 s ¹⁾	
Temperature			
Measurement range (barometric pressur limit) ²⁾		-40 +60 °C (-40 .	+140 °F)
Measurement range, probes (operational limit when measuring RH or T)		PTU301: -40 +60 PTU303: -40 +80 PTU307: -40 +180 (-40 +356 °F) PTU30T: -70 +180 (-94 +356 °F) ³⁾	°C (-40 +176 °F)) °C
Accuracy at +20 °C (+68 °F)		PTU301, PTU303, P (±0.4 °F) PTU30/T: ±0.1 °C (±	
Temperature units		°C, °F	
Temperature sensor	Temperature sensor		0.1 IEC 60751
1) With HUMICAP 180R or	180RC sensor		

With HUMICAP 180R or 180RC sensor
 Note that the operational temperature limits of the PTU303, PTU307, and PTU30T probes are higher than for the PTU300 transmitter itself. The transmitter's temperature limit is based on the upper temperature limit for barometric pressure measurement, +60 °C
 PTU30T is used for T and P measurements only, RH measurement not in use.

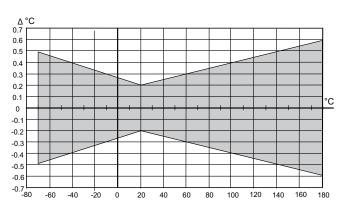

Accuracy over Temperature Range

Operating Environment

Operating temperature	-40 +60 °C (-40 +140 °F)	
Operating temperature with optional display	0 +60 °C (+32 +140 °F)	
Humidity range	Non-condensing	
EMC compliance	EN61326-1, Industrial Environment	
Note: Transmitter with display test impedance of 40 Ω is used in IEC61000-4-5 (Surge immunity)		

Mechanical Specifications

Cable bushing	M20 x 1.5 for cable diameter 8 11 mm/0.31 0.43"
Conduit fitting	1/2" NPT
User cable connector (optional) Option 1 Option 2	M12 series 8-pin (male) Female plug with 5 m (16.4 ft) black cable Female plug with screw terminals
Cable diameter, PTU303	6.0 mm
Cable diameter, other probes	5.5 mm
Standard probe cable lengths	2 m, 5 m or 10 m ¹⁾
Housing material	G-AlSi 10 Mg (DIN 1725)
IP rating	IP66 IP65 (NEMA4X) with local display
Weight (depending on selected probe)	1.0 - 3.0 kgs

1) Additional cable lengths available, please see order form for details.

Optional Data Logger with Real-time Clock

Logged parameters	Max. four with trend/min/max values
Logging interval	10 s (fixed)
Maximum logging period with maximum temporal resolution	4 years 5 months
Logged points	13.7 million points per parameter
Battery lifetime	Min. 5 years

Display


Material	LCD with backlight, graphical trend display of any parameter
Menu languages	English, Chinese, Finnish, French, German, Japanese, Russian, Spanish, Swedish

Inputs and Outputs

Settling time at power-up (one sensor)Class A: 4 s Class B: 3 sRecommended wire size0.5 mm² (AWG 20) stranded wiresDigital outputsRS-232, RS-485 (optional)ProtocolsASCII commands, Modbus RTUService connectionRS-232, USBRelay outputs (optional)0.5 A, 250 VAC Power Consumption at +20 °C (Uin 24 UUTS) RS-232Max. 28 mAUout 3 x 0 1 V/O 5 V/O 10 VMax. 33 mAIout 3 x 0 20 mAMax. 63 mADisplay and backlight+20 mADuring chemical purgeMax. +110 mADuring probe heating+120 mACurrent outputsRL < 500 Ω0 1 V outputRL < 500 Ω0 1 V outputRL < 2 kΩ0 1 V outputRL < 10 kΩDuring probe heating+210 kΩ0 1 V outputRL < 10 kΩ0 1 V outputRL < 2 kΩ0 1 V outputRL < 2 kΩ0 1 V output0.0BASE-T, 100BASE-TX0 5 V and 0 10 V outputsPB8C (RJ45)1 Pv4 address assignmentDHCP (automatic), static1 Pv4 address assignment0.01 V outp.10 V1 Pv4 address assignment0.0.1 V outp.10 V1 Purdity and Temperature:40.0.5 % full scale1 Purdity and Temperature:40.0.5 % full scale1 Purdity and Temperature:40.005% full scale1 Purdit	Operating voltage With optional power supply module	10 35 VDC, 24 VAC ±20 % 100 240 VAC, 50/60 Hz	
Digital outputsRS-232, RS-485 (optional)ProtocolsASCII commands, Modbus RTUService connectionRS-232, USBRelay outputs (optional)0.5 A, 250 VAC Power Consumption at +20 °C (Uin 24 UUS)RS-232Max. 28 mAUout 3 × 0 1 V/0 5 V/0 10 VMax. 33 mAlout 3 × 0 20 mAMax. 63 mADisplay and backlight+20 mADuring chemical purgeMax. +110 mADuring probe heating+120 mAExternal LoadsVourge NameCurrent outputsRL < 500 Ω	Settling time at power-up (one sensor)		
ProtocolsASCII commands, Modbus RTUService connectionRS-232, USBRelay outputs (optional)0.5 A, 250 VAC Power Consumption at +20 °C (Uin 24 UUE)RS-232Max. 28 mAUout 3 x 0 1V/0 5 V/0 10 VMax. 33 mAIout 3 x 0 20 mAMax. 63 mADisplay and backlight+20 mADuring chemical purgeMax. +110 mADuring probe heating+120 mACurrent outputsRL < 500 Ω	Recommended wire size	0.5 mm ² (AWG 20) stranded wires	
Service connectionRS-232, USBRelay outputs (optional)0.5 A, 250 VACPower Consumption at +20 °C (U _{In} 24 UUC)RS-232Max. 28 mAUout 3 x 0 1 V/0 5 V/0 10 VMax. 33 mAIout 3 x 0 1 V/0 5 V/0 10 VMax. 33 mAIout 3 x 0 20 mAMax. 63 mADisplay and backlight+20 mADuring chemical purgeMax. +110 mADuring probe heating+120 mACurrent outputsRL < 500 Ω	Digital outputs	RS-232, RS-485 (optional)	
Relay outputs (optional)0.5 A, 250 VACPower Consumption at +20°C (U _{In} 24 UTC)RS-232Max. 28 mAUout 3 x 0 1 V/0 5 V/0 10 VMax. 33 mAlout 3 x 0 20 mAMax. 63 mADisplay and backlight+20 mADuring chemical purgeMax. +110 mADuring probe heating+120 mACurrent outputsRL < 500 Ω	Protocols	ASCII commands, Modbus RTU	
Power Consumption at +20 °C (U _{in} 24 VDC) RS-232 Max. 28 mA U _{out} 3 x 0 1 V/0 5 V/0 10 V Max. 33 mA I _{out} 3 x 0 20 mA Max. 63 mA Display and backlight +20 mA During chemical purge Max. +110 mA During probe heating +120 mA During probe heating +120 mA Current outputs RL < 500 Ω	Service connection	RS-232, USB	
RS-232 Max. 28 mA U _{out} 3 x 0 1 V/0 5 V/0 10 V Max. 33 mA I _{out} 3 x 0 20 mA Max. 63 mA Display and backlight +20 mA During chemical purge Max. +110 mA During probe heating +120 mA External Loads Current outputs RL < 500 Ω	Relay outputs (optional)	0.5 A, 250 VAC	
Uout 3 × 0 1 V/0 5 V/0 10 V Max. 33 mA Iout 3 × 0 20 mA Max. 63 mA Display and backlight +20 mA During chemical purge Max. +110 mA During probe heating +120 mA External Loads Iour and a construction of the action	Power Consumption at +20 °C (U _{in} 24 VDC)		
Iout 3 x 0 20 mA Max. 63 mA Display and backlight +20 mA During chemical purge Max. +110 mA During probe heating +120 mA External Loads Image: Current outputs Current outputs RL < 500 Ω	RS-232	Max. 28 mA	
Display and backlight +20 mA During chemical purge Max. +110 mA During probe heating +120 mA External Loads External Loads Current outputs RL < 500 Ω	U _{out} 3 x 0 1 V/0 5 V/0 10 V	Max. 33 mA	
During chemical purge Max. +110 mA During probe heating +120 mA External Loads E Current outputs RL < 500 Ω	l _{out} 3 x 0 20 mA	Max. 63 mA	
During probe heating +120 mA External Loads RL < 500 Ω	Display and backlight	+20 mA	
External LoadsExternal LoadsCurrent outputs $R_L < 500 \Omega$ $01V$ output $R_L > 2 k\Omega$ $05V$ and $010V$ outputs $R_L > 10 k\Omega$ Ethernet Interface (Optional)Supported standards10BASE-T, 100BASE-TXConnector8P8C (RJ45)IPv4 address assignmentDHCP (automatic), staticProtocolsTelnet, Modbus TCP/IPAnalog Outputs (Optional)Current output $020 mA, 420 mA$ Voltage output $01V, 05 V, 010 V$ Humidity and Temperature: 40.05% full scaleAccuracy of analog outputs at $+20^{\circ}$ C $\pm0.05\%^{\circ}$ full scalePressure: $40.30 hPa (5001100 hPa)$ Accuracy of analog outputs at $+20^{\circ}$ C $\pm0.30 hPa (5001100 hPa)$ Accuracy of analog outputs at $+20^{\circ}$ C $\pm0.60 hPa (5001100 hPa)$	During chemical purge	Max. +110 mA	
Current outputs $R_L < 500 \Omega$ 01 V output $R_L > 2 k\Omega$ 05 V and 010 V outputs $R_L > 10 k\Omega$ Ethernet Interface (Optional)Supported standards10BASE-T, 100BASE-TXConnector8P8C (RJ45)IPv4 address assignmentDHCP (automatic), staticProtocolsTelnet, Modbus TCP/IPCurrent output0 20 mA, 4 20 mAVoltage output0 1V, 0 5 V, 0 10 VHumidity and Temperature:±0.005%/°C full scaleAccuracy of analog outputs at +20 °C±0.005%/°C full scalePressure:±0.30 hPa (500 1100 hPa) ±0.40 hPa (50 1100 hPa)Accuracy of analog outputs at +20 °C±0.60 hPa (500 1100 hPa)	During probe heating	+120 mA	
$01V$ output $R_L > 2 k\Omega$ $05V$ and $010V$ outputs $R_L > 10 k\Omega$ Ethernet Interface (Optional) IDBASE-T, 100BASE-TX Supported standards 10BASE-T, 100BASE-TX Connector 8P8C (RJ45) IPv4 address assignment DHCP (automatic), static Protocols Telnet, Modbus TCP/IP Analog Outputs (Optional) $020 mA, 420 mA$ Voltage output $01V, 05 V, 010 V$ Hurnidity and Temperature: 4.005% full scale Accuracy of analog outputs at +20 °C $\pm 0.05\%$ full scale Pressure: $4.0.30$ hPa (5001100 hPa) Accuracy of analog outputs at +20 °C ± 0.30 hPa (5001100 hPa) Accuracy of analog outputs at +20 °C $\pm 0.30 hPa (5001100 hPa) Accuracy of analog outputs at +20 °C \pm 0.30 hPa (5001100 hPa) $	External Loads		
0 5 V and 0 10 V outputs R _L > 10 kΩ Ethernet Interface (Optional) Supported standards 10BASE-T, 100BASE-TX Connector 8P8C (RJ45) IPv4 address assignment DHCP (automatic), static Protocols Telnet, Modbus TCP/IP Analog Outputs (Optional) Current output 0 20 mA, 4 20 mA Voltage output 0 1V, 0 5 V, 0 10 V Humidity and Temperature: Accuracy of analog outputs at +20 °C ±0.05% full scale Pressure: Accuracy of analog outputs at +20 °C ±0.30 hPa (500 1100 hPa) Accuracy of analog outputs at +20 °C ±0.30 hPa (500 1100 hPa) Accuracy of analog outputs at +20 °C ±0.30 hPa (500 1100 hPa)	Current outputs	R _L < 500 Ω	
Ethernet Interface (Optional)Supported standards10BASE-T, 100BASE-TXConnector8P8C (RJ45)IPv4 address assignmentDHCP (automatic), staticProtocolsTelnet, Modbus TCP/IPAnalog Outputs (Optional)0 20 mA, 4 20 mAYoltage output0 1V, 0 5 V, 0 10 VHumidity and Temperature:40.05% full scaleAccuracy of analog outputs at +20 °C±0.005%/°C full scalePressure:	0 1 V output	$R_L > 2 k\Omega$	
Supported standards10BASE-T, 100BASE-TXConnector8P8C (RJ45)IPv4 address assignmentDHCP (automatic), staticProtocolsTelnet, Modbus TCP/IPAnalog Outputs (Optional)0 20 mA, 4 20 mAVoltage output0 1V, 0 5 V, 0 10 VHumidity and Temperature:±0.05% full scaleAccuracy of analog outputs at +20 °C±0.05% /°C full scalePressure:±0.005% /°C full scalePressure:±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.60 hPa (500 1100 hPa)	0 5 V and 0 10 V outputs	$R_L > 10 k\Omega$	
Connector8P8C (RJ45)IPv4 address assignmentDHCP (automatic), staticProtocolsTelnet, Modbus TCP/IPAnalog Outputs (Optional)0 20 mA, 4 20 mACurrent output0 20 mA, 4 20 mAVoltage output0 1V, 0 5 V, 0 10 VHumidity and Temperature:±0.05% full scaleAccuracy of analog outputs at +20 °C±0.05% full scalePressure:±0.05% full scaleAccuracy of analog outputs at +20 °C±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.60 hPa (500 1100 hPa)	Ethernet Interface (Optional)		
IPv4 address assignmentDHCP (automatic), staticProtocolsTelnet, Modbus TCP/IPAnalog Outputs (Optional)0 20 mA, 4 20 mACurrent output0 20 mA, 4 20 mAVoltage output0 1V, 0 5 V, 0 10 VHumidity and Temperature:±0.05% full scaleAccuracy of analog outputs at +20 °C±0.05% full scalePrepsrature dependence of analog outputs±0.005%/°C full scalePressure:±0.005%/°C full scaleAccuracy of analog outputs at +20 °C±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.60 hPa (500 1100 hPa)	Supported standards	10BASE-T, 100BASE-TX	
ProtocolsTelnet, Modbus TCP/IPAnalog Outputs (Optional)Current output0 20 mA, 4 20 mAVoltage output0 1V, 0 5 V, 0 10 VHumidity and Temperature:Accuracy of analog outputs at +20 °C±0.05% full scaleTemperature dependence of analog outputs±0.005%/°C full scalePressure:Accuracy of analog outputs at +20 °C±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.60 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.60 hPa (500 1100 hPa)	Connector	8P8C (RJ45)	
Analog Outputs (Optional)Current output0 20 mA, 4 20 mAVoltage output0 1V, 0 5 V, 0 10 VHumidity and Temperature:40.05% full scaleAccuracy of analog outputs at +20 °C±0.05%/°C full scaleTemperature dependence of analog outputs±0.005%/°C full scalePressure:±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at±0.60 hPa (500 1100 hPa)	IPv4 address assignment	DHCP (automatic), static	
Current output0 20 mA, 4 20 mAVoltage output0 1 V, 0 5 V, 0 10 VHumidity and Temperature:±0.05% full scaleAccuracy of analog outputs at +20 °C±0.05% full scaleTemperature dependence of analog outputs±0.005%/°C full scalePressure:±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.60 hPa (500 1100 hPa)Accuracy of analog outputs at±0.60 hPa (500 1100 hPa)	Protocols	Telnet, Modbus TCP/IP	
Voltage output0 1 V, 0 5 V, 0 10 VHumidity and Temperature:Accuracy of analog outputs at +20 °CTemperature dependence of analog outputsPressure:Accuracy of analog outputs at +20 °C4ccuracy of analog outputs at +20 °Cbressure:Accuracy of analog outputs at +20 °C±0.30 hPa (500 1100 hPa) ±0.40 hPa (500 1100 hPa)Accuracy of analog outputs at±0.60 hPa (500 1100 hPa)	Analog Outputs (Optional)		
Humidity and Temperature: Accuracy of analog outputs at +20 °C ±0.05% full scale Temperature dependence of analog outputs ±0.005%/°C full scale outputs ±0.005%/°C full scale Pressure: ±0.30 hPa (500 1100 hPa) Accuracy of analog outputs at +20 °C ±0.30 hPa (500 1100 hPa) ±0.40 hPa (50 1100 hPa) ±0.60 hPa (500 1100 hPa)	Current output	0 20 mA, 4 20 mA	
Accuracy of analog outputs at +20 °C±0.05% full scaleTemperature dependence of analog outputs±0.005%/°C full scalePressure:Accuracy of analog outputs at +20 °C±0.30 hPa (500 1100 hPa)Accuracy of analog outputs at +20 °C±0.40 hPa (500 1100 hPa)Accuracy of analog outputs at±0.60 hPa (500 1100 hPa)	Voltage output	0 1 V, 0 5 V, 0 10 V	
Temperature dependence of analog outputs ±0.005%/°C full scale Pressure: ±0.30 hPa (500 1100 hPa) Accuracy of analog outputs at +20 °C ±0.30 hPa (500 1100 hPa) ±0.40 hPa (500 1100 hPa) ±0.60 hPa (500 1100 hPa)	Humidity and Temperature:		
outputs Pressure: Accuracy of analog outputs at +20 °C ±0.30 hPa (500 1100 hPa) ±0.40 hPa (50 1100 hPa) Accuracy of analog outputs at ±0.60 hPa (500 1100 hPa)	Accuracy of analog outputs at +20 °C	±0.05% full scale	
Accuracy of analog outputs at +20 °C ±0.30 hPa (500 1100 hPa) ±0.40 hPa (50 1100 hPa) ±0.60 hPa (500 1100 hPa)		±0.005%/°C full scale	
±0.40 hPa (50 1100 hPa) Accuracy of analog outputs at ±0.60 hPa (500 1100 hPa)	Pressure:		
	Accuracy of analog outputs at +20 °C		

Spare Parts and Accessories

PC software and cable	215005
USB-RJ45 Serial Connection Cable	219685
Connection cable for HM70	211339
Wall mounting plate (plastic)	214829
Pole installation kit with rain shield	215109
DIN rail installation set	211477
Duct installation kit, PTU303/307	210697
Cable gland and AGRO, PTU303/307	HMP247CG
Solar radiation shield, PTU303/307/30T	DTR502B
Meteorological installation kit	HMT330MIK
Duct installation kit (T probe)	215003

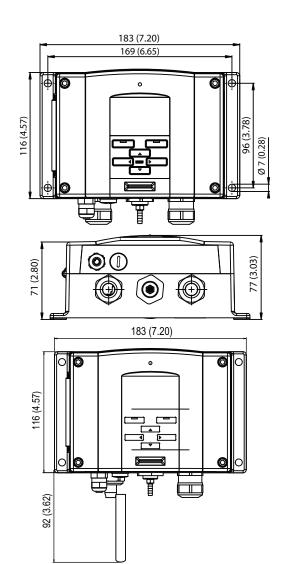

Dimensions in mm (inches)

CE

Published by Vaisala | B210954EN-F $\ensuremath{\mathbb{C}}$ Vaisala 2017

All rights reserved. Any logos and/or product names are trademarks of Vaisala or its individual partners. Any reproduction, transfer, distribution or storage of information contained in this document is strictly prohibited. All specifications — technical included — are subject to change without notice.

